
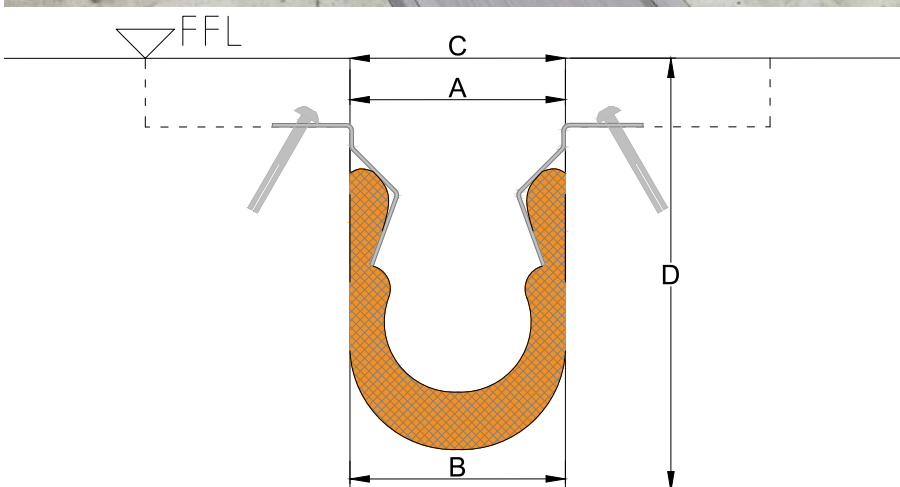
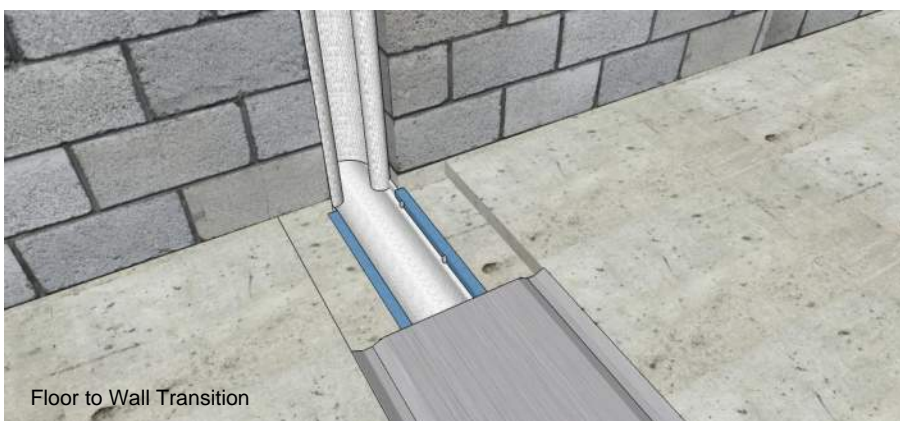


Pyrotx B Fire Blankets for EJs

Pyrotx B: Designed to accommodate seismic activity, PyB is a very high movement fire-blanket system. The PyB is tested/certified to Australian and British standards for gaps of 250mm.... with movement well in excess of this. PyB can be used in masonry walls and floors, and can be applied in conjunction with a range of Unison coverplate systems.

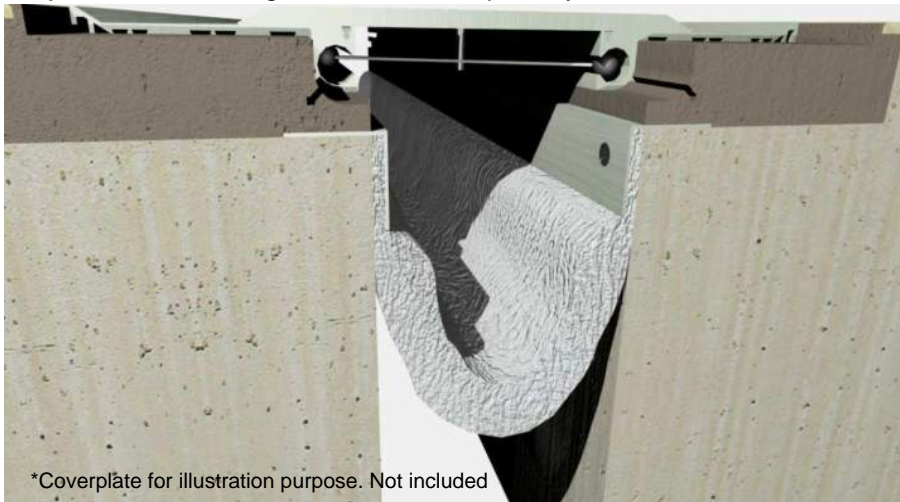

Product	A: Seal		B: Gap				C: Installation Width
	Width	Thick	Min.	Mid.	Max.	Mvmt.	
Py25/300B	300	25	50	113	175	125	70
Py25/400B	400	25	50	163	275	225	70
Py25/600B	600	25	50	263	475	425	70
Py25/300B Soffit	300	25	0	75	150	150	>0

Block Out: Minimum Element Thickness D 120mm

Disclaimer: All design rights reserved. Design and specifications are subject to change without notice. The manufacturer does not accept liability where the material on these pages is misconceived, exploited, or lacks conformity. The intention of this information is to provide a reasonable description of products, procedures and capabilities. Rev.7

THE ART OF COVERPLATES

unison
JOINTS

Py B

Previous Model No: UFB

Indoor

Outdoor

Multi-directional

Performance

- Expansion Joint Fireseal
- High fire resistance
- High movement capacity
- Certified to 250mm gaps
- Floor application
- Wall system seals both sides
- Compatible with coverplates & water seals
- Tested and comply with:

AS 1530.4
AS 4072.1
BS 476.20

Standard Length

7.2m

This document remains Unison
Joists Pty. Ltd.'s property.
COMMERCIAL IN CONFIDENCE

Exova Warringtonfire App Pty Ltd
150A Englewood Road
Warrington NSW 2106
Australia
T: +61 02 850 5028
P: +61 02 850 5028
E: info@exova.com.au

Testing, Advancing, Assuring

EWFA CERTIFICATE OF ASSESSMENT		CERTIFICATE No: SFC 27465-01		Page 1 of 1
Report Sponsor	Certificate Issue Date	Product Name		
Unison Joists Pty Ltd 150A Englewood Road Warrington NSW 2106 Australia	19/07/2016	25mm FIREMASTER Blanket Control Joint		
Assessment Reference	Referenced Standard	Report Issue Date	Report Validity Date	
EWFA 27465-00	AS 1530.4-2005	30/07/2012	31/07/2017	
Introduction				
The element of construction described below was assessed by this laboratory on behalf of the report sponsor in accordance with the stated test standard and achieved the results stated below. Refer to the referenced test report(s) or Regulatory Information Reports for a complete description of the assessed construction.				
Assessed Control Joint description and performance				
Control Joint	Orientation of Joint	Support Element	Opening Width	Direction of Exposure
A FIREMASTER Blanket 25mm thick	Horizontally or vertically	Concrete or Masonry Wall	70mm to 100mm wide 100mm to 250mm wide	Fire from either side
FRL				
>040/120				
Refer the referenced report for a complete description of the assessed construction.				
Continuing Validity				
THIS CERTIFICATE IS PROVIDED FOR GENERAL INFORMATION ONLY AND DOES NOT COMPLY WITH THE REGULATORY REQUIREMENTS FOR EVIDENCE OF COMPLIANCE.				
Reference should be made to the relevant test report or regulatory information report to determine the applicability of the test result to a proposed installation. Full details of the construction and justification for the conditions given, along with the validity statements, are given in the assessment reports.				
The assessment report or short form assessment report does not provide an endorsement by Exova Warringtonfire App Pty Ltd of the performance of the actual products supplied. It is intended to provide a brief outline of the above referenced assessment reports and not to replace them.				
The conditions in this certificate of assessment relate to the configurations as detailed, and should not be applied to any other configuration. The conditions expressed in this document assess the hazard, but it should be recognised that a single test method will not provide a full assessment of the hazard under all conditions.				
Full copies of the assessment and relevant test reports may be obtained from the sponsor.				
TESTING AUTHORITY	Exova Warringtonfire App Pty Ltd			
Address	Suite 100/10A, Level 10, 44 Theobald Street, Sydney NSW 2000, Australia			
Phone - Fax	+61 (02) 850 5028 / +61 (02) 850 5028			
URL	E: info@exova.com.au			
Email - Home Page	www.exova.com.au			
Authorisation	Reviewed By	Reviewed By		
	<i>[Signature]</i>	<i>[Signature]</i>		
	S. Hu	D. Nicholson		